







# Classes of Flammable and Combustible Liquids as Defined in 29 CFR 1910.106



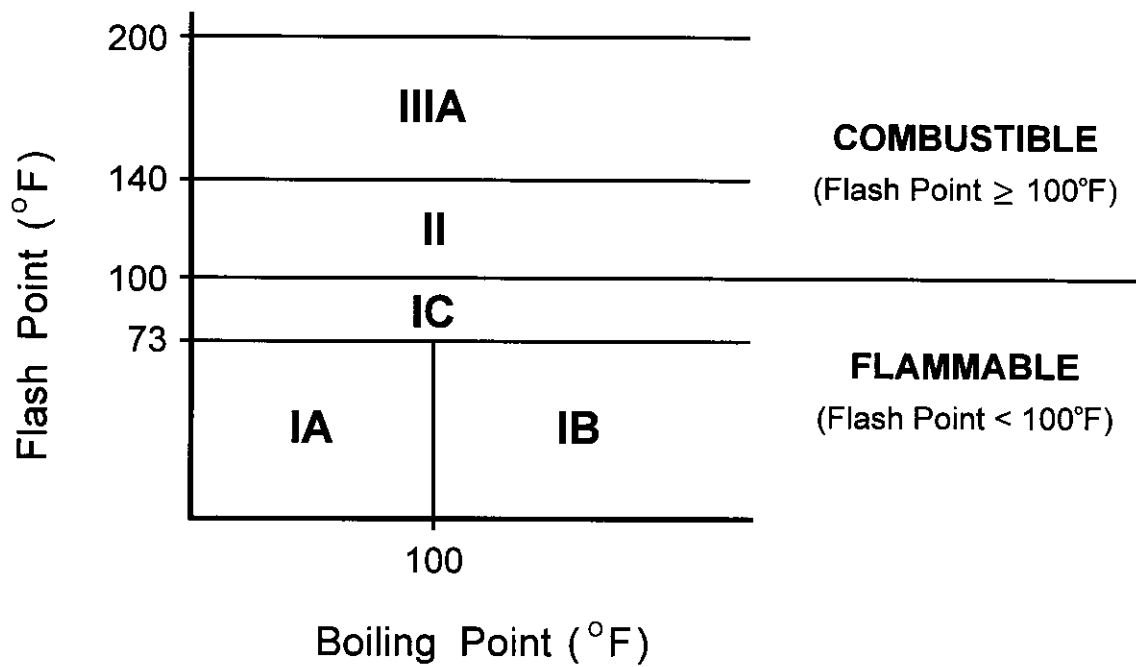

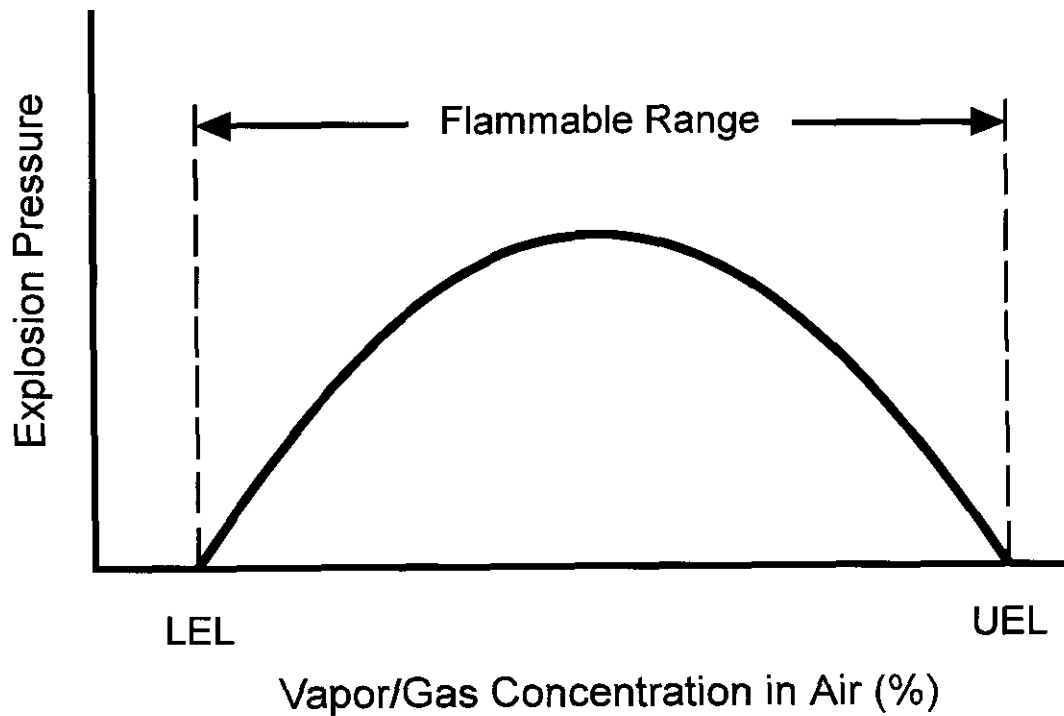

In popular jargon, a vapor/air mixture below the flammable limit is too "lean" to burn or explode, and a mixture above the upper flammable limit is too "rich" to burn or explode. No attempt is made to differentiate between the terms *flammable* and *explosive* as applied to the lower and upper limits of flammability.





## Rating and Capacity

Storage in inside storage rooms shall comply with the following:

STORAGE IN INSIDE ROOMS			
Fire Protection Provided <sup>2</sup>	Fire Resistance	Maximum Floor Area (ft <sup>2</sup> )	Total Allowable Quantities (gal/ft <sup>2</sup> floor area)
Yes	2 hr.	500	10
No	2 hr.	500	4*
Yes	1 hr.	150	5*
No	1 hr.	150	2

\* NOTE: These numbers are incorrectly shown in 29 CFR 1910.106.

- Requirements for electrical wiring and equipment, ventilation, and maintenance of aisles at least 3 feet wide are also included
- Dispensing shall be only by approved pump or self-closing faucet

---

<sup>2</sup> Fire protection system shall be sprinkler, water spray, carbon dioxide, or other system.





